




# 1050H20TL6NB CAT 4

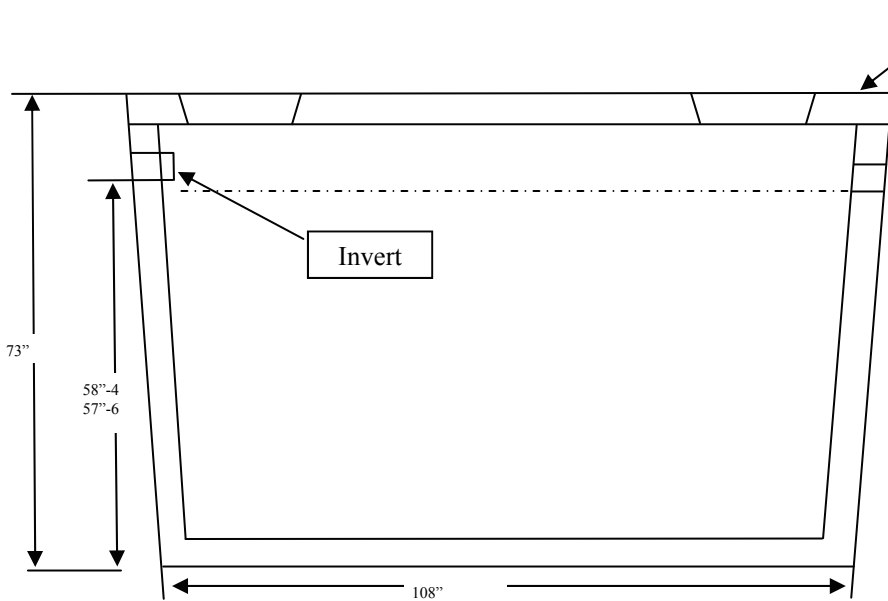

Side View

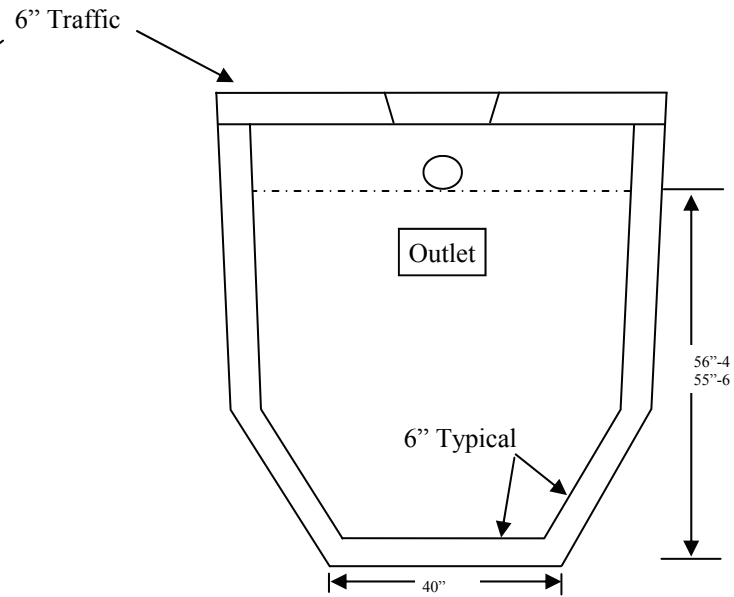

End View

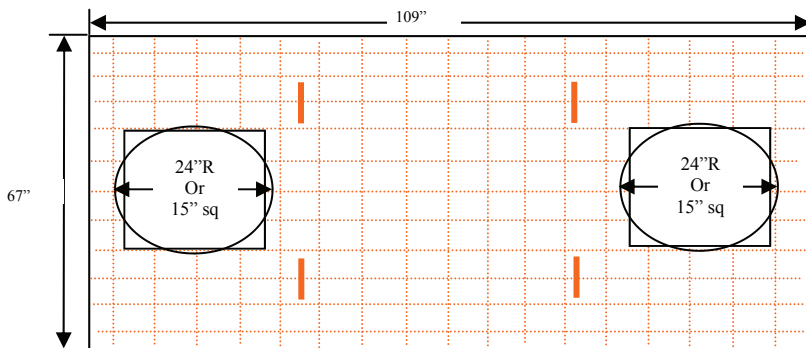

Lid View

Not to scale

Notes:

Receptacle has been designed and tested in accordance with Florida Administrative Code (FAC) 381 Chapter 64E-6.

When receptacle is used as a pump chamber use 19.8 gallons per inch when configuring float placement.

Polylok VI High Pressure Closed End Boot Seal (Accepts 4" & 6" Pipe) It also meets ASTM C-923 specifications and can fit in a 3"- 6.5" wall with pipe and tighten take up clamp.

## Sebring Septic Tank

*Big Enough To Serve. Small Enough To Care*

**1050H20TL6NB CAT4**  
**State Approval # 28-015-10S**

**Overall liquid capacity.....1215 Gallons**  
**Capacity to outlet hole.....1050 Gallons**  
**Capacity of air space..... 165 Gallons**

**Concrete @ 4000psi . Air space calculated @ 15% minimum. Steel placement in tank lid ; #6 grade 60 deformed rebar 6" OC, both ways. Walls are reinforced with #4 grade 60 deformed rebar 6" OC. Max cover 6'**